


GENERAL NOTES:

- ① FALL THROUGH THE HYDRO-KINETIC® PLANT FROM INLET INVERT TO OUTLET INVERT IS FIVE INCHES. INLET INVERT IS TWELVE INCHES BELOW TANK TOP.
- ② ON DEEPER INSTALLATIONS, PRECAST RISERS MUST BE USED TO EXTEND CASTINGS TO GRADE. INSPECTION COVERS MUST BE DEVELOPED TO WITHIN TWELVE INCHES OF GRADE.
- ③ TANK REINFORCED PER ACI STD. 318.
- ④ REMOVABLE COVERS ON RISERS WEIGH IN EXCESS OF SEVENTY-FIVE POUNDS EACH TO PREVENT UNAUTHORIZED ACCESS.
- ⑤ CONTACT THE LOCAL, LICENSED HYDRO-KINETIC® DISTRIBUTOR FOR ELECTRICAL REQUIREMENTS.

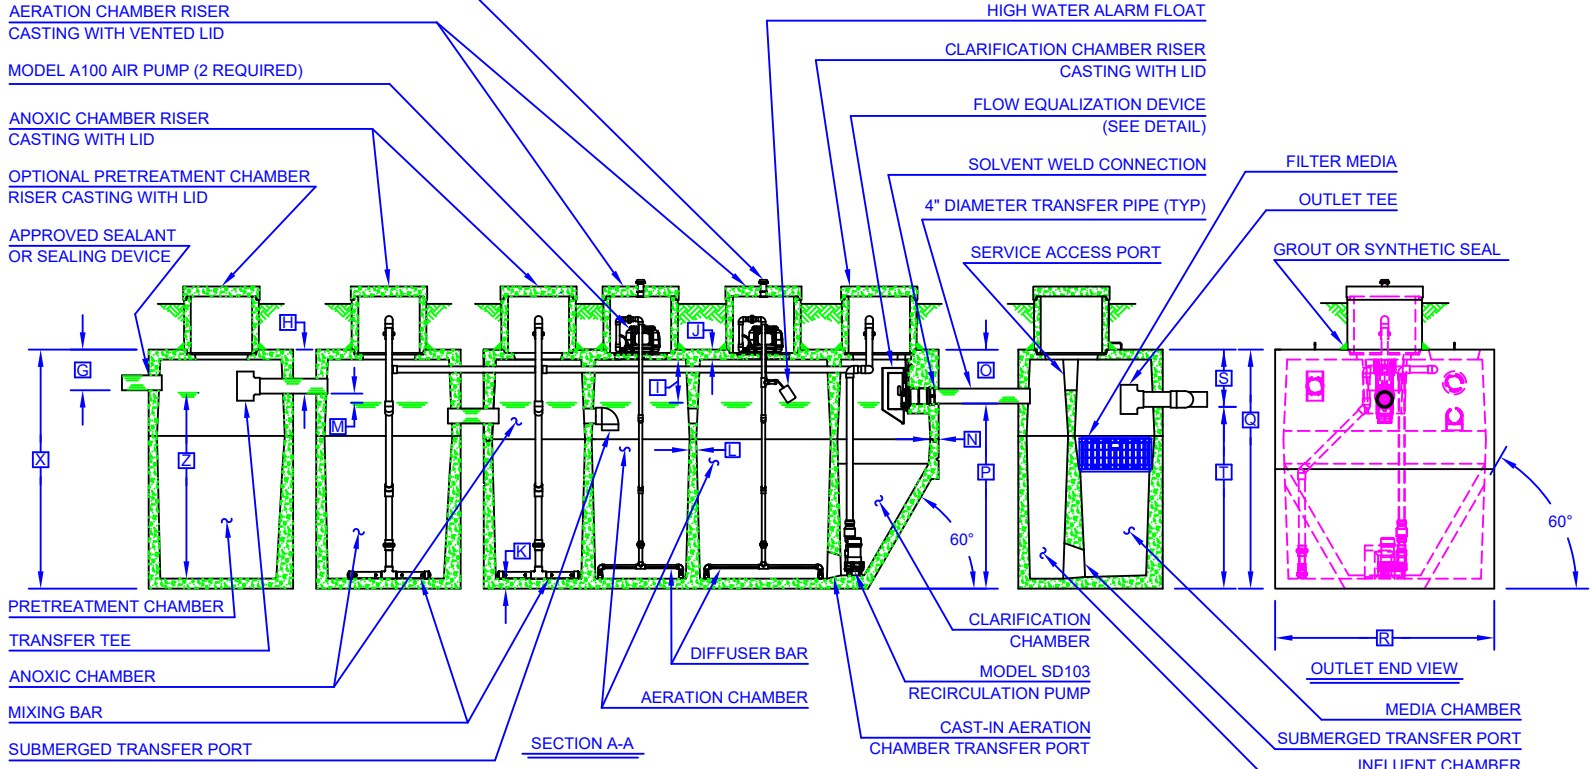

NOTE: PRETREATMENT CHAMBER MINIMUM REQUIREMENTS SHALL BE: 1,000 GALLONS CAPACITY, 15 GALLONS PER INCH OF LIQUID LEVEL AND 9 INCHES OF FREEBOARD.

NOTE: EXTERNAL ANOXIC CHAMBER MINIMUM REQUIREMENTS SHALL BE: 450 GALLONS CAPACITY, 7 GALLONS PER INCH OF LIQUID LEVEL AND 12 INCHES OF FREEBOARD.

NOTE: TOTAL SYSTEM CAPACITY: 4,550 GALLONS
RATED CAPACITY: 1,500 GALLONS PER DAY

PROJECT ENGINEER'S APPROVAL:
I (WE) HEREBY CERTIFY THAT THIS DRAWING HAS BEEN CHECKED AND IS APPROVED FOR USE IN CONFORMITY WITH THE CONTRACT DOCUMENTS.

DATE: _____

NAME: _____

CONTRACTOR'S CERTIFICATION:
I (WE) HEREBY CERTIFY THAT THIS DRAWING HAS BEEN CHECKED AND IS APPROVED FOR USE IN CONFORMITY WITH THE CONTRACT DOCUMENTS.

DATE: _____

NAME: _____

CRITICAL DIMENSIONS

A	1'-0"	N	0'-2 1/2"
B	2'-4"	O	1'-4"
C	2'-5 1/2"	P	6'-8"
D	3'-4 1/2"	Q	8'-0"
E	2'-4"	R	5'-6"
F	11'-5"	S	1'-5"
G	1'-0"	T	6'-7"
H	1'-1"	U	3'-7 1/2"
I	1'-1"	V	
J	0'-3"	W	
K	0'-3"	X	
L	0'-2"	Y	
M	0'-3"	Z	

U.S. AND FOREIGN PATENTS PENDING		REVISION DATE	REVISION
		APPROVED BY	JMM
© MMXXII	HYDRO-KINETIC® MODEL 1500 FEU WASTEWATER TREATMENT SYSTEM	DATE	9-18-13
		SCALE	NTS
<small>THIS DRAWING IS THE PROPERTY OF NORWECO. NO PARTS MAY BE REPRODUCED OR TRANSMITTED IN ANY FORM OR BY ANY MEANS WITHOUT WRITTEN PERMISSION FROM NORWECO.</small>		DRAWING NO.	PC-5-1031